

1.

0

 $\geq$

Q.

2000

OPGW

65000


273

Nj^a A A A A X^m A Ä , A J

Hs

ε λ “

Ρ λ :

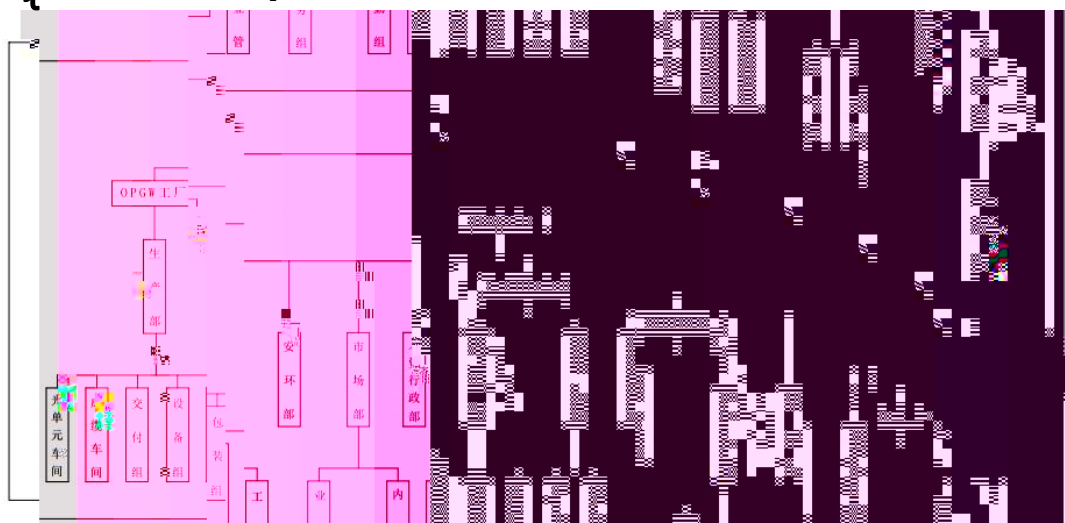

3.1

λ /

4.1 / k

4.2

77

82

35

PCT

5

4



2

4.3 | ۱ ٲ ٲ ٲ !! ۱

21

2

1	IEEE 1138-2021	IEEE Standard for Testing and Performance for Optical Ground Wire (OPGW) for Use on Electric Utility Power Lines OPGW	
2	IEEE 1595-2022	IEEE Standard for Testing and Performance for Optical Phase Conductor (OPPC) for Use on Electrical Utility Power Lines ----- OPPC	
3	IEC	1-404	- -

	60794-1-404-2022-0	-	H4			
	2					
	IEC	1-220	-	-	-	
4	60794-1-220-2022		F20			
5	IEEE 1591.1-2023	IEEE Standard for Testing and Performance of Hardware for Optical Ground Wire (OPGW)				
6	Q/GDW 761-2012		OPGW			
7	CSN EN 60794-4-10	4-10				
8	GBT 17937-2024					
9	DL/T 832-2016					
10	DL/T 1613-2016					
11	DL/T 1601-2016					
12	DL/T 1733-2017					
13	YB/T 4682-2018					
14	T/CEC 186-2018					

4.5 ı k

“ - ”

“ ”

3



” ı H

”

”

“

”

AAA

2024

“

AA

”

” ı H

6.1

ISO 14001

ISO 45001

2024

6.2 f U 72L, 2.5tC02e

ó9 Ö 8% 1_ AŃ²4×#_ČŠŃŃ•
HF3
4 Aî n :‡ E.ã ŋ ǎ ˘~ 0G 5k
10362.96kWh
¾

‡ meø

! b ˘

b

.@

2@

m ' w,,



ᵇ € ƆM M Ɔ

0

7 7

6.4

“ ”

CSR

CSR

CSR

“

Ε

’ 9 2 9 α
θ

α

Ⓢ

* 1 ’

ij + qΣ

↓

]

ω

α v

q, q, θ 1 ’

ε

“ ”

7.1 “ ”

“

”

” ı u

8.1 ” U n f

100%

8.2 ı H

8.3 u ı

“ ”

1

400

800

2000

“ ”

2

3

“ ”

“ ”

8.4 k ă `H

8.5 l

8.6 u م ĩ

H. v. 1914

9.1





				$\leq 65\text{dB}$			
				$\leq 55\text{dB}$			100%
				100%			

9.2 €

“ ”

(1)

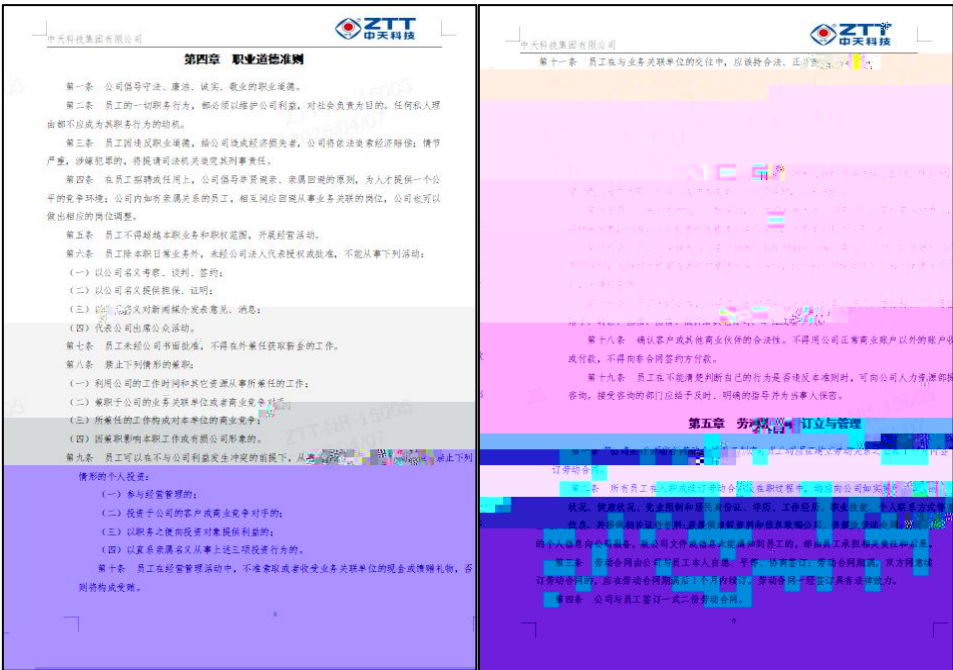

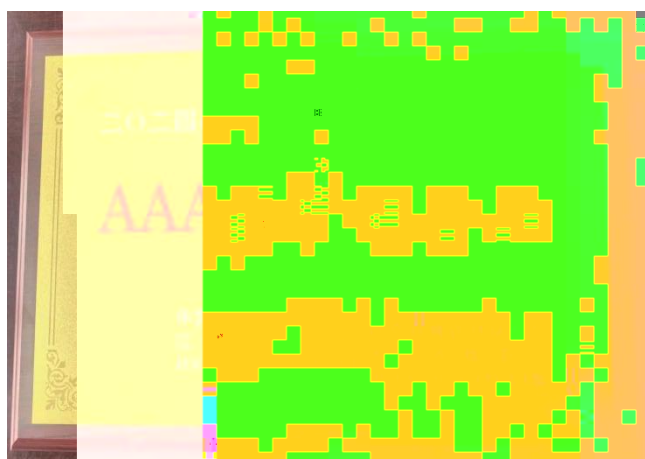

2024 4 , 330kV OPGW

2024 “ 9.6 ” “ ”



7

